


ASSEMBLY INSTRUCTION

WARM WATER

Scheme shows max. No of heating pads per control unit

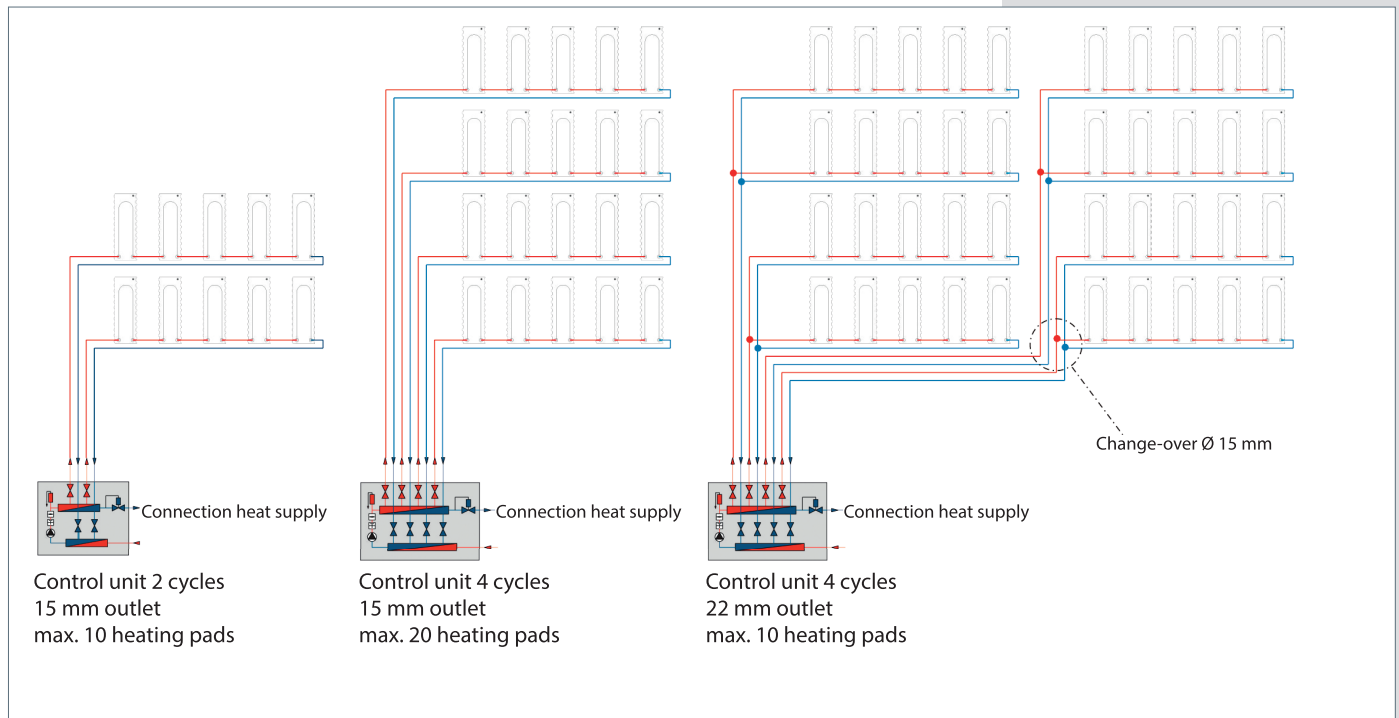

WARM WATER

Installation scheme: control unit 4 cycles with 15 mm pipeline

